SIEMENS

Data sheet

3RT2028-2AL20



power contactor, AC-3e/AC-3, 38 A, 18.5 kW / 400 V, 3-pole, 230 V AC, 50/60 Hz, auxiliary contacts: 1 NO + 1 NC, spring-loaded terminal, size: S0

product brand name product designation	SIRIUS				
product designation	Power contactor				
product designation	Power contactor				
product type designation	3RT2				
General technical data					
size of contactor	S0				
product extension					
function module for communication	No				
auxiliary switch	Yes				
power loss [W] for rated value of the current					
at AC in hot operating state	9.6 W				
• at AC in hot operating state per pole	3.2 W				
without load current share typical	10.5 W				
insulation voltage					
of main circuit with degree of pollution 3 rated value	690 V				
of auxiliary circuit with degree of pollution 3 rated value	690 V				
surge voltage resistance					
of main circuit rated value	6 kV				
of auxiliary circuit rated value	6 kV				
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V				
shock resistance at rectangular impulse					
• at AC	8,3g / 5 ms, 5,3g / 10 ms				
shock resistance with sine pulse					
• at AC	13,5g / 5 ms, 8,3g / 10 ms				
mechanical service life (operating cycles)					
of contactor typical	10 000 000				
 of the contactor with added electronically optimized auxiliary switch block typical 	5 000 000				
of the contactor with added auxiliary switch block typical	10 000 000				
reference code according to IEC 81346-2	Q				
Substance Prohibitance (Date)	10/01/2009				
Ambient conditions					
installation altitude at height above sea level maximum	2 000 m				
ambient temperature					
during operation	-25 +60 °C				
during storage	-55 +80 °C				
relative humidity minimum	10 %				
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %				
Main circuit					
number of poles for main current circuit	3				

number of NO contacts for main contacts	3
operating voltage	
at AC-3 rated value maximum	690 V
 at AC-3e rated value maximum 	690 V
operational current	
• at AC-1 at 400 V at ambient temperature 40 °C rated	50 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated value	50 A
— up to 690 V at ambient temperature 60 °C rated	42 A
value	
• at AC-3	
— at 400 V rated value	38 A
— at 500 V rated value	32 A
— at 690 V rated value	21 A
• at AC-3e	
— at 400 V rated value	38 A
— at 500 V rated value	32 A
— at 690 V rated value	21 A
at AC-4 at 400 V rated value	22 A
at AC-5a up to 690 V rated value	44 A
• at AC-5b up to 400 V rated value	31.5 A
• at AC-6a	30.8 A
— up to 230 V for current peak value n=20 rated value	
— up to 400 V for current peak value n=20 rated value	30.8 A 30.8 A
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	21 A
• at AC-6a	21A
 up to 230 V for current peak value n=30 rated value 	20.5 A
— up to 200 V for current peak value n=30 rated value	20.5 A
— up to 500 V for current peak value n=30 rated value	21.4 A
— up to 690 V for current peak value n=30 rated value	21 A
minimum cross-section in main circuit at maximum AC-1 rated	10 mm ²
value	
operational current for approx. 200000 operating cycles at AC-4	
at 400 V rated value	12 A
at 690 V rated value	12 A
operational current	
 at 1 current path at DC-1 	
— at 24 V rated value	35 A
— at 60 V rated value	20 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
• with 2 current paths in series at DC-1	
— at 24 V rated value	35 A
— at 60 V rated value	35 A
— at 110 V rated value	35 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
 with 3 current paths in series at DC-1 	
— at 24 V rated value	35 A
— at 60 V rated value	35 A
— at 110 V rated value	35 A
— at 220 V rated value	35 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
 at 1 current path at DC-3 at DC-5 	

— at 24 V rated value	20 A
— at 60 V rated value	5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.09 A
— at 600 V rated value	0.06 A
 with 2 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	35 A
— at 60 V rated value	35 A
— at 110 V rated value	15 A
— at 220 V rated value	3 A
— at 440 V rated value	0.27 A
— at 600 V rated value	0.16 A
 with 3 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	35 A
— at 60 V rated value	35 A
— at 110 V rated value	35 A
— at 220 V rated value	10 A
— at 440 V rated value	0.6 A
— at 600 V rated value	0.6 A
operating power	
• at AC-3	
- at 230 V rated value	11 kW
— at 200 V rated value	18.5 kW
— at 500 V rated value	18.5 kW
— at 690 V rated value	18.5 kW
• at AC-3e	10.5 KW
- at 230 V rated value	11 kW
— at 400 V rated value	18.5 kW
— at 500 V rated value	18.5 kW
— at 690 V rated value	18.5 kW
operating power for approx. 200000 operating cycles at AC- 4	
4	
 at 400 V rated value 	6 kW
	6 kW 10.3 kW
• at 400 V rated value	
at 400 V rated valueat 690 V rated value	
at 400 V rated value at 690 V rated value operating apparent power at AC-6a	10.3 kW
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value 	10.3 kW 12.2 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	10.3 kW 12.2 kVA 21.3 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 18.5 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 18.5 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 18.5 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 18.5 kVA 25 kVA
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 500 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rat	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 690 V for current peak value n=30 rated value to 10 s switching at zero current maximum l	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 500 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency <	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value to 50 S switching at zero current maximum t	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 1000 1/h 750 1/h
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 60 s switching at zero current maximum	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 750 1/h 750 1/h 750 1/h
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC-1 maximum at AC-1 maximum at AC-3 maximum at AC-3 maximum at AC-3 maximum at AC-4 maximum 	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 1000 1/h 750 1/h
 at 400 V rated value at 690 V rated value operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value to 500 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 60 s switching at zero current maximum	10.3 kW 12.2 kVA 21.3 kVA 26.6 kVA 25 kVA 8.1 kVA 14.2 kVA 14.2 kVA 14.2 kVA 18.5 kVA 25 kVA 593 A; Use minimum cross-section acc. to AC-1 rated value 341 A; Use minimum cross-section acc. to AC-1 rated value 260 A; Use minimum cross-section acc. to AC-1 rated value 199 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 162 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 750 1/h 750 1/h 750 1/h

control supply voltage at AC	
• at 50 Hz rated value	230 V
at 60 Hz rated value	230 V
operating range factor control supply voltage rated value of magnet coil at AC	
• at 50 Hz	0.8 1.1
• at 60 Hz	0.85 1.1
apparent pick-up power of magnet coil at AC	
● at 50 Hz	81 VA
● at 60 Hz	79 VA
inductive power factor with closing power of the coil	
● at 50 Hz	0.72
• at 60 Hz	0.74
apparent holding power of magnet coil at AC	
• at 50 Hz	10.5 VA
• at 60 Hz	8.5 VA
inductive power factor with the holding power of the coil	
• at 50 Hz	0.25
• at 60 Hz	0.28
closing delay	
• at AC	8 40 ms
opening delay	
• at AC	4 16 ms
arcing time	10 10 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous contact	1
number of NO contacts for auxiliary contacts instantaneous contact	1
operational current at AC-12 maximum	10 A
operational current at AC-15	
• at 230 V rated value	10 A
• at 400 V rated value	3 A
• at 500 V rated value	2 A
• at 690 V rated value	1 A
operational current at DC-12	
at 24 V rated value	10 A
• at 48 V rated value	6 A
• at 60 V rated value	6 A
• at 110 V rated value	3 A
• at 125 V rated value	2 A
• at 220 V rated value	1 A
• at 600 V rated value	0.15 A
operational current at DC-13	
at 24 V rated value	10 A
at 48 V rated value	2 A
at 60 V rated value	2 A
at 110 V rated value	1 A
at 125 V rated value	0.9 A
at 220 V rated value	0.3 A
at 600 V rated value	0.1 A
contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
at 480 V rated value	34 A
at 460 V rated value at 600 V rated value	27 A
yielded mechanical performance [hp]	
for single-phase AC motor at 110/120 V rated value	2 hn
— at 110/120 V rated value	3 hp 5 hp
 — at 230 V rated value 	

 for 3-phase AC motor 				
	0 hp			
	10 hp			
	25 hp			
	25 hp			
	A600 / P600			
Short-circuit protection				
design of the fuse link				
for short-circuit protection of the main circuit				
	G: 125A (690V,100kA), aM: 50A (690V,100kA), BS88: 125A (415V,80kA)			
	gG: 50A (690V,100kA), aM: 25A (690V, 100kA), BS88: 50A (415V, 80kA)			
	IG: 10 A (500 V, 1 kA)			
Installation/ mounting/ dimensions				
	/-180° rotation possible on vertical mounting surface; can be tilted forward and			
ba	ackward by +/- 22.5° on vertical mounting surface			
fastening method so	crew and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715			
side-by-side mounting Ye	/es			
	02 mm			
	5 mm			
•	7 mm			
required spacing				
with side-by-side mounting				
	0 mm			
	0 mm			
	0 mm			
) mm			
for grounded parts				
	0 mm			
	0 mm			
	nm			
	0 mm			
for live parts	•			
	0 mm			
	0 mm			
	0 mm			
	i mm			
Connections/ Terminals				
type of electrical connection	pring loaded terminale			
	pring-loaded terminals			
	pring-loaded terminals			
	Spring-type terminals			
• of magnet con type of connectable conductor cross-sections for main contacts	Spring-type terminals			
	2x (1 10 mm²)			
	x (1 10 mm ²)			
	$x (1 6 mm^2)$			
	x (1 6 mm ²)			
connectable conductor cross-section for main contacts				
	10 mm²			
	10 mm ²			
	6 mm²			
	6 mm²			
connectable conductor cross-section for auxiliary contacts				
	0.5 2.5 mm²			
	0.5 1.5 mm²			
	0.5 2.5 mm ²			
type of connectable conductor cross-sections				
for auxiliary contacts				
	2x (0.5 2.5 mm²)			
	x (0.5 1.5 mm ²)			
	x (0.5 2.5 mm²)			

• for AWG cables	for auxiliary contacts		2x (20 1	4)		
	ed connectable conducto	r cross	27 (20)	(*)		
for main contacts		18 8				
for auxiliary contacts		20 14				
Safety related data						
product function						
 mirror contact a 	ccording to IEC 60947-4-1		Yes			
B10 value with high demand rate according to SN 31920		450 000				
proportion of dangerous failures						
with low demand rate according to SN 31920		40 %				
 with high deman 	nd rate according to SN 319	20	73 %			
failure rate [FIT] with lo	ow demand rate according	o SN 31920	100 FIT			
T1 value for proof test 61508	interval or service life acco	rding to IEC	20 a			
protection class IP o	n the front according to I	EC 60529	IP20			
touch protection on	the front according to IEC	60529	finger-safe	e, for vertical contac	t from the front	
suitability for use						
 safety-related st 	witching OFF		Yes			
Certificates/ approvals	;					
General Product App	proval					
		<u>Confirmatio</u>	n		KC	EHC
EMC	Functional Safety/Safety of Ma- chinery	Declaration of	Conformity		Test Certificates	
RCM	<u>Type Examination Cer-</u> <u>tificate</u>	UK CA	Ì	CE EG-Konf.	<u>Type Test Certific-</u> ates/Test Report	<u>Special Test Certific-</u> <u>ate</u>
Marine / Shipping						
ABS	B U R E A U VERITAS			Lloyd's Register urs	PRS	RINA
Marine / Shipping	other				Railway	Environment
RAMES	Confirmation	DE)	<u>Confirmation</u>	Vibration and Shock	Environmental Con- firmations
Further information Siemens has decided to exit the Russian market (see here).						

Siemens has decided to exit the Russian market (see here). https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates. Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging https://support.industry.siemens.com/cs/ww/en/view/109813875

Information- and Downloadcenter (Catalogs, Brochures,...)


https://www.siemens.com/ic10


Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT2028-2AL20


Cax online generator


http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RT2028-2AL20


Service&Support (Manuals, Certificates, Characteristics, FAQs,...) https://support.industry.siemens.com/cs/ww/en/ps/3RT2028-2AL20 Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT2028-2AL20&lang=en Characteristic: Tripping characteristics, I²t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RT2028-2AL20/char Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2028-2AL20&objecttype=14&gridview=view1







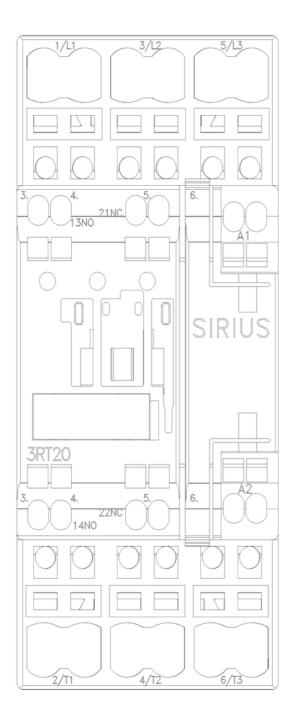

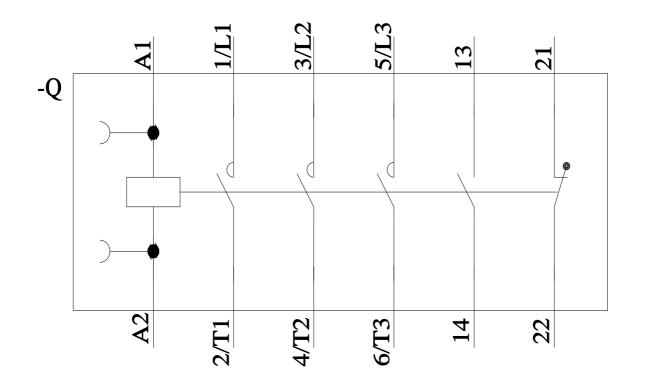

last modified:

2/10/2023 🖸