SIEMENS

Data sheet

3RT2038-3AL20



power contactor, AC-3e/AC-3, 80 A, 37 kW / 400 V, 3-pole, 230 V AC, 50/60 Hz, auxiliary contacts: 1 NO + 1 NC, main circuit: screw terminal, control and auxiliary circuit: spring-loaded terminal, size: S2

product brand name	SIRIUS
product designation	Power contactor
product type designation	3RT2
General technical data	
size of contactor	S2
product extension	
 function module for communication 	No
 auxiliary switch 	Yes
power loss [W] for rated value of the current	
 at AC in hot operating state 	17.1 W
 at AC in hot operating state per pole 	5.7 W
 without load current share typical 	17.2 W
insulation voltage	
 of main circuit with degree of pollution 3 rated value 	690 V
 of auxiliary circuit with degree of pollution 3 rated value 	690 V
surge voltage resistance	
 of main circuit rated value 	6 kV
 of auxiliary circuit rated value 	6 kV
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V
shock resistance at rectangular impulse	
• at AC	11.8g / 5 ms, 7.4g / 10 ms
shock resistance with sine pulse	
• at AC	18.5g / 5 ms, 11.6g / 10 ms
mechanical service life (operating cycles)	
 of contactor typical 	10 000 000
 of the contactor with added electronically optimized auxiliary switch block typical 	5 000 000
 of the contactor with added auxiliary switch block typical 	10 000 000
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2014
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
during operation	-25 +60 °C
during storage	-55 +80 °C
relative humidity minimum	10 %
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %
Main circuit	
number of poles for main current circuit	3

number of NO contacts for main contacts	3
operating voltage	5
at AC-3 rated value maximum	690 V
at AC-3e rated value maximum	690 V
operational current	
at AC-1 at 400 V at ambient temperature 40 °C rated	90 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated	90 A
value	
— up to 690 V at ambient temperature 60 °C rated value	80 A
• at AC-3	
— at 400 V rated value	80 A
— at 500 V rated value	80 A
— at 690 V rated value	58 A
● at AC-3e	
— at 400 V rated value	80 A
— at 500 V rated value	80 A
— at 690 V rated value	58 A
• at AC-4 at 400 V rated value	55 A
• at AC-5a up to 690 V rated value	79.2 A
• at AC-5b up to 400 V rated value	66.4 A
• at AC-6a	
 — up to 230 V for current peak value n=20 rated value 	70 A
 — up to 400 V for current peak value n=20 rated value 	70 A
 — up to 500 V for current peak value n=20 rated value 	70 A
 — up to 690 V for current peak value n=20 rated value 	58 A
● at AC-6a	
 — up to 230 V for current peak value n=30 rated value 	46.7 A
 — up to 400 V for current peak value n=30 rated value 	46.7 A
 — up to 500 V for current peak value n=30 rated value 	46.7 A
— up to 690 V for current peak value n=30 rated value	46.7 A
minimum cross-section in main circuit at maximum AC-1 rated value	35 mm ²
operational current for approx. 200000 operating cycles at AC-4	
• at 400 V rated value	30 A
• at 690 V rated value	24 A
operational current	
 at 1 current path at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	23 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
with 2 current paths in series at DC-1	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	45 A
— at 220 V rated value	5 A
— at 440 V rated value	1A
— at 600 V rated value	0.8 A
with 3 current paths in series at DC-1	55 A
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	45 A
— at 440 V rated value	2.9 A
 — at 600 V rated value at 1 current path at DC-3 at DC-5 	1.4 A
- at i current patri at DC-3 at DC-3	


— at 24 V rated value	35 A				
— at 60 V rated value	6 A				
— at 220 V rated value	1 A				
— at 440 V rated value	0.1 A				
— at 600 V rated value	0.06 A				
 with 2 current paths in series at DC-3 at DC-5 					
— at 24 V rated value	55 A				
— at 60 V rated value	45 A				
— at 110 V rated value	25 A				
— at 220 V rated value	5 A				
— at 440 V rated value	0.27 A				
— at 600 V rated value	0.16 A				
 with 3 current paths in series at DC-3 at DC-5 					
— at 24 V rated value	55 A				
— at 60 V rated value	55 A				
— at 110 V rated value	55 A				
— at 220 V rated value	25 A				
— at 440 V rated value	0.6 A				
— at 600 V rated value	0.35 A				
operating power					
• at AC-2 at 400 V rated value	37 kW				
• at AC-3					
— at 230 V rated value	22 kW				
— at 400 V rated value	37 kW				
— at 500 V rated value	37 kW				
— at 690 V rated value	45 kW				
• at AC-3e					
— at 230 V rated value	22 kW				
— at 400 V rated value	37 kW				
— at 500 V rated value	37 kW				
— at 690 V rated value	45 kW				
operating power for approx. 200000 operating cycles at AC-					
4					
• at 400 V rated value	15.8 kW				
at 690 V rated value	21.8 kW				
operating apparent power at AC-6a					
 up to 230 V for current peak value n=20 rated value 	27.8 kVA				
	48.4 kVA				
 up to 400 V for current peak value n=20 rated value 					
• up to 500 V for current peak value n=20 rated value	60.6 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	60.6 kVA 69.3 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a	69.3 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value 	69.3 kVA 18.6 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	69.3 kVA 18.6 kVA 32.3 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	69.3 kVA 18.6 kVA 32.3 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC-1 maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC-1 maximum at AC-2 maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC-1 maximum at AC-2 maximum at AC-3 maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h 500 1/h				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 5 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC-1 maximum at AC-3 maximum at AC-3 maximum at AC-3 maximum at AC-3 maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 500 1/h 500 1/h				
 up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC-1 maximum at AC-2 maximum at AC-3 maximum 	69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h 500 1/h				


type of voltage of the control supply voltage	AC			
control supply voltage at AC				
• at 50 Hz rated value	230 V			
• at 60 Hz rated value	230 V			
operating range factor control supply voltage rated value of magnet coil at AC				
• at 50 Hz	0.8 1.1			
• at 60 Hz	0.85 1.1			
apparent pick-up power of magnet coil at AC				
• at 50 Hz	210 VA			
• at 60 Hz	188 VA			
inductive power factor with closing power of the coil				
• at 50 Hz	0.69			
• at 60 Hz	0.65			
apparent holding power of magnet coil at AC				
• at 50 Hz	17.2 VA			
• at 60 Hz	16.5 VA			
inductive power factor with the holding power of the coil				
• at 50 Hz	0.36			
• at 60 Hz	0.39			
closing delay				
• at AC	10 80 ms			
opening delay				
• at AC	10 18 ms			
arcing time	10 20 ms			
control version of the switch operating mechanism	Standard A1 - A2			
Auxiliary circuit				
number of NC contacts for auxiliary contacts instantaneous	1			
contact number of NO contacts for auxiliary contacts instantaneous	1			
contact				
operational current at AC-12 maximum	10 A			
operational current at AC-15	40.4			
at 230 V rated value	10 A			
at 400 V rated value	3 A			
at 500 V rated value	2 A			
at 690 V rated value	1 A			
operational current at DC-12	10.4			
at 24 V rated value	10 A			
at 48 V rated value	6 A			
at 60 V rated value	6 A			
at 110 V rated value	3 A			
at 125 V rated value	2 A			
at 220 V rated value	1A			
at 600 V rated value	0.15 A			
operational current at DC-13				
at 24 V rated value	10 A			
 at 48 V rated value 	2 A			
• at 60 V rated value	2 A			
• at 110 V rated value	1 A			
at 110 V rated valueat 125 V rated value	1 A 0.9 A			
 at 110 V rated value at 125 V rated value at 220 V rated value 	1 A 0.9 A 0.3 A			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value 	1 A 0.9 A 0.3 A 0.1 A			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value contact reliability of auxiliary contacts	1 A 0.9 A 0.3 A			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value 	1 A 0.9 A 0.3 A 0.1 A			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value contact reliability of auxiliary contacts	1 A 0.9 A 0.3 A 0.1 A			
at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value contact reliability of auxiliary contacts UL/CSA ratings	1 A 0.9 A 0.3 A 0.1 A			
at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value contact reliability of auxiliary contacts UL/CSA ratings full-load current (FLA) for 3-phase AC motor	1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA)			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value contact reliability of auxiliary contacts UL/CSA ratings full-load current (FLA) for 3-phase AC motor at 480 V rated value 	1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 65 A			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value UL/CSA ratings full-load current (FLA) for 3-phase AC motor at 480 V rated value at 600 V rated value 	1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 65 A			
 at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value contact reliability of auxiliary contacts UL/CSA ratings full-load current (FLA) for 3-phase AC motor at 480 V rated value at 600 V rated value at 600 V rated value 	1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 65 A			

— at 230 V rated value	15 hp			
• for 3-phase AC motor				
— at 200/208 V rated value	20 hp			
— at 220/230 V rated value	25 hp			
— at 460/480 V rated value	50 hp			
— at 575/600 V rated value	60 hp			
contact rating of auxiliary contacts according to UL	A600 / P600			
Short-circuit protection				
design of the fuse link				
 for short-circuit protection of the main circuit 				
— with type of coordination 1 required	gG: 250 A (690 V, 100 kA), aM: 160 A (690 V, 100 kA), BS88: 200 A (415 V, 80 kA)			
 — with type of assignment 2 required 	gG: 160A (690V,100kA), aM: 80A (690V,100kA), BS88: 125A (415V,80kA)			
 for short-circuit protection of the auxiliary switch required 	gG: 10 A (500 V, 1 kA)			
Installation/ mounting/ dimensions				
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface			
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715			
side-by-side mounting	Yes			
height	114 mm			
width	55 mm			
depth	130 mm			
required spacing				
with side-by-side mounting				
— forwards	10 mm			
— upwards	10 mm			
— downwards	10 mm			
— at the side	0 mm			
for grounded parts	0 mm			
— forwards	10 mm			
— upwards	10 mm			
— upwards — at the side	6 mm			
— downwards	10 mm			
 for live parts — forwards 	10 mm			
— upwards	10 mm			
— downwards	10 mm			
— at the side	6 mm			
Connections/ Terminals				
type of electrical connection				
for main current circuit	screw-type terminals			
for auxiliary and control circuit	spring-loaded terminals			
at contactor for auxiliary contacts	Spring-type terminals			
of magnet coil	Spring-type terminals			
type of connectable conductor cross-sections for main contacts				
solid or stranded	2x (1 35 mm ²), 1x (1 50 mm ²)			
finely stranded with core end processing	2x (1 25 mm²), 1x (1 35 mm²)			
connectable conductor cross-section for main contacts	4 05 mm2			
finely stranded with core end processing	1 35 mm²			
connectable conductor cross-section for auxiliary contacts	0.5 0.5 mm²			
solid or stranded	0.5 2.5 mm ²			
finely stranded with core end processing	0.5 1.5 mm ²			
finely stranded without core end processing	0.5 2.5 mm ²			
type of connectable conductor cross-sections				
for auxiliary contacts	$2 \times (0.5 - 0.5 \text{ mm}^2)$			
— solid or stranded	2x (0.5 2.5 mm ²)			
 finely stranded with core end processing 	2x (0.5 1.5 mm²)			
 finely stranded without core end processing 	2x (0.5 2.5 mm ²)			
for AWG cables for auxiliary contacts	2x (20 14)			
AWG number as coded connectable conductor cross section				

• for main contact			18 1			
 for auxiliary con 	tacts		20 14			
Safety related data						
product function			N.			
	tact according to IEC 60947-4-1		Yes			
 positively driven operation according to IEC 60947-5-1 		No				
	emand rate according to SN	31920	1 000 000			
proportion of dangerous failures						
	d rate according to SN 319		40 %			
	with high demand rate according to SN 31920		73 %			
	ow demand rate according		100 FIT			
T1 value for proof test 61508	interval or service life acco	rding to IEC	20 a			
	protection class IP on the front according to IEC 60529		IP20			
-	the front according to IEC		finger-safe, for vertical contact from the front			
suitability for use			iniger care, ier tertical certa			
 safety-related sy 	witching OFF		Yes			
Certificates/ approvals	0					
General Product App	· · · · · · · · · · · · · · · · · · ·					
General Product App	Jroval					
(SP)		<u>Confirmatio</u>		KC	EHC	
EMC	Functional Safety/Safety of Ma- chinery	Declaration of	Conformity	Test Certificates		
RCM	<u>Type Examination Cer-</u> <u>tificate</u>	UK CA	CE EG-Konf.	<u>Special Test Certific-</u> <u>ate</u>	<u>Type Test Certific-</u> ates/Test Report	
Marine / Shipping						
ABS	BUREAU VERITAS		Lloyd's Register us	PRS	RINA	
Marine / Shipping	other		Railway	Dangerous Good	Environment	
RMRS	<u>Confirmation</u>	<u>Confirmatio</u>	n <u>Vibration and Shock</u>	Transport Information	Environmental Con- firmations	
Further information	te evit the Dueslan mult					
Siemens has decided to exit the Russian market (see here). https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business						
Siemens is working on the renewal of the current EAC certificates. Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus). Information on the packaging https://support.industry.siemens.com/cs/ww/en/view/109813875						
	Information- and Downloadcenter (Catalogs, Brochures,) https://www.siemens.com/ic10					
Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT2038-3AL20						
Cax online generator	Cax online generator http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RT2038-3AL20					
				<u>20</u>		
	anuals, Certificates, Chara 		,)			
Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros,)						

Subject to change without notice © Copyright Siemens http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT2038-3AL20&lang=en Characteristic: Tripping characteristics, I²t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RT2038-3AL20/char Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2038-3AL20&objecttype=14&gridview=view1

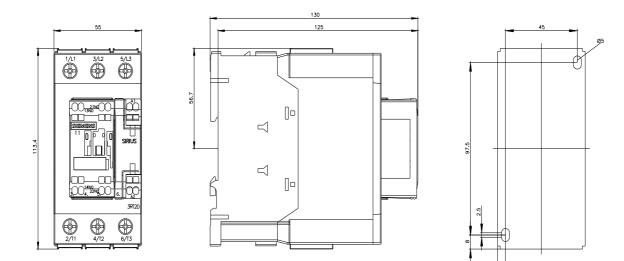

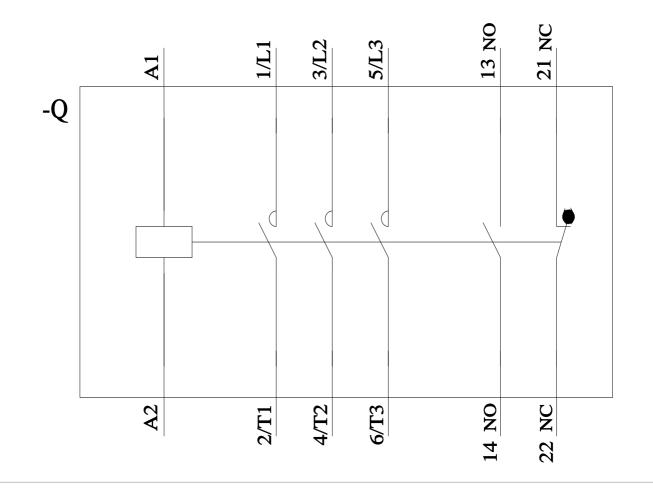

last modified:

2/10/2023 🖸