
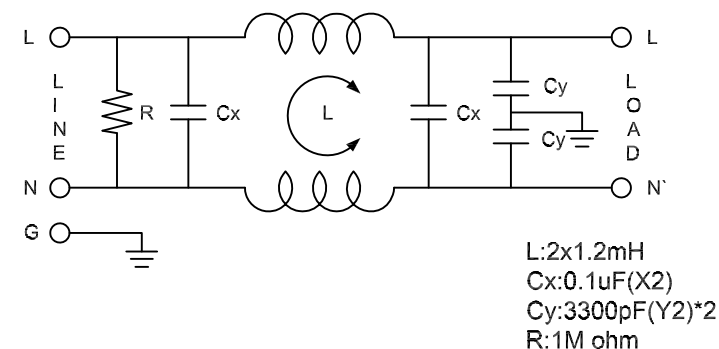
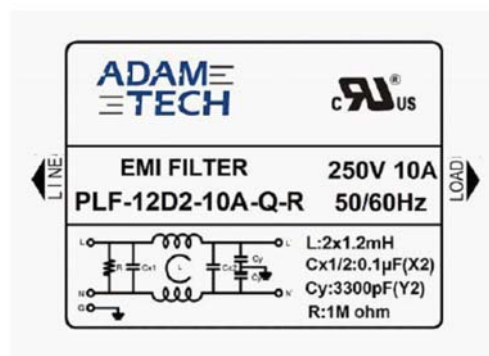


APPROVED: _____
DATE: _____ TITLE: _____

Rev	AWO #	Description	Date	Appr
-		RELEASED	9/23/21	
A		UPDATE DRAWING	4/11/22	WX/RC
B		ADDED DRAWING	5/27/22	WX/RC

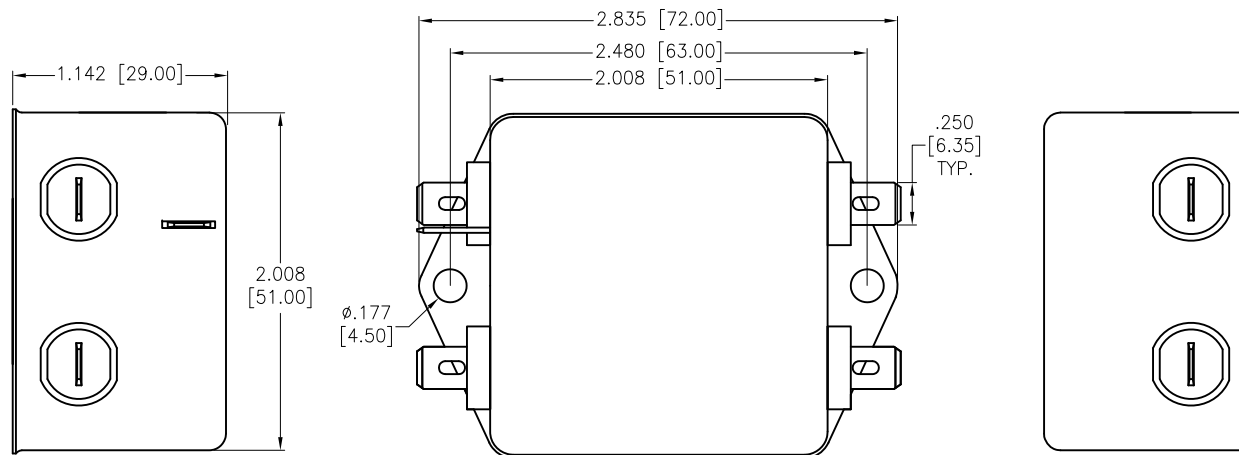

SPECIFICATIONS:

Electrical:

Voltage rating: 115/250 VAC

Current rating: 115/250 VAC: 10A RMS max

Operating Frequency: 50/60Hz

Leakage Current: Each Line To Ground

@115VAC/60HZ 0.4mA max

@250VAC/50HZ 0.8mA max

Hipot Rating(For 1 Minute)

A. Line to Ground: 2,250 VDC

B. Line to Line: 500 VDC

IR: 50 Mohm @500 VDC Any Input or Output to Ground

Temperature Rating:

-25°C to +85°C

Environmental:

Lead free, RoHS compliant



UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE INCHES [MM]. TOLERANCES: EXCEPT AS NOTED

INCHES	HOLES
.X $\pm$.10	ϕ .X $\pm$.10
.XX $\pm$.020	ϕ .XX $\pm$.015
.XXX $\pm$.015	ϕ .XXX $\pm$.010

DRAWN	JJ	9/23/21
CHECKED	RC	9/23/21
APPROVED		

THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY AND SHOULD NOT BE USED WITHOUT PRIOR WRITTEN PERMISSION FROM ADAM TECH

ADAM TECH

909 Rahway Avenue,
Union, NJ 07083
Phone: 908-687-5000
Fax: 908-687-5710

TITLE "EMI/RF POWER FILTER MEDIUM
OUTLINE, CHASSIS MOUNT

SIZE X	PART NO. PLF-12D2-10A-Q-R	REV. B
REF: S00205C	SCALE: NTS	SHEET 1 OF 2

6

5

4

3

2

1

APPROVED: _____

DATE: _____ TITLE: _____

Rev

AWO #

Description

Date


Appr

SEE SHT 1 OF 2 FOR REVISION

INSERTION LOSS(IN 50 ohm system according IEC/CISPR

(common mode)

(differential mode)

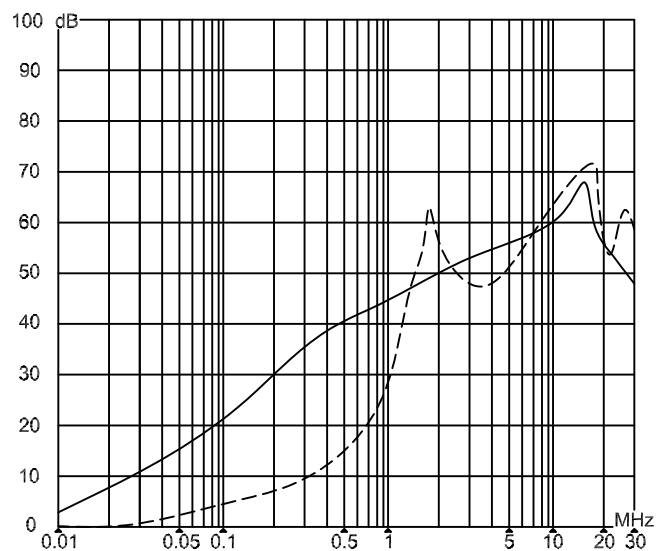UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS
ARE INCHES [MM]. TOLERANCES: EXCEPT AS NOTED

INCHES		HOLES	
.X	± .10	Ø.X	±.10
.XX	± .020	Ø.XX	±.015
.XXX	± .015	Ø.XXX	±.010

DRAWN

JJ

9/23/21

CHECKED

RC

9/23/21

APPROVED

THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY
AND SHOULD NOT BE USED WITHOUT PRIOR WRITTEN
PERMISSION FROM ADAM TECH**ADAM**
TECH909 Rahway Avenue,
Union, NJ 07083
Phone: 908-687-5000
Fax: 908-687-5710

TITLE

"EMI/RF POWER FILTER MEDIUM
OUTLINE, CHASSIS MOUNTSIZE
X

PART NO.

PLF-12D2-10A-Q-R

REV.
B

REF: S00205C

SCALE: NTS

SHEET 2 OF 2

6

5

4

3

2

1