

Figure 1.1. Top View of AHV24VN5KV1MAW

Figure 1.2. Side View

Figure 1.3. Side View

Figure 1.4. Side View

Figure 1.5. Bottom View

FEATURES

- Input Power Voltage: $24V \pm 1V$
- Input Current Range: 65mA to 400mA
- Output Voltage: 0 to $-5kV$ @CTRL = 0 to 5V
- Max. Output Current: 1mA
- Reference Voltage: $5V \pm 0.05V$
- Input Control Voltage: 0 to 5V
- Full Span Modulation on Output Voltage
- Electronic Shutdown Control

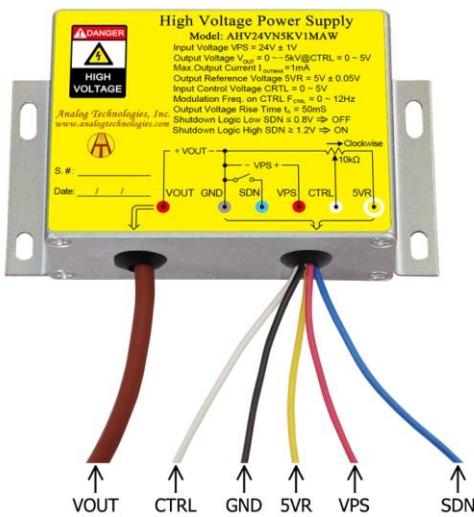


Figure 2. The Connecting Lead Wires of AHV24VN5KV1MAW

APPLICATIONS

This power module, AHV24VN5KV1MAW, is designed for achieving DC-DC conversion from low voltage to high voltage as a power supply source which is widely used in scientific research and other fields including:

- X-ray Machine
- Spectral Analysis
- Nondestructive Inspection
- Semiconductor Manufacturing Equipment
- CRT Monitor Test
- Particle Accelerator
- Capillary Electrophoresis
- Particles Injection
- Semiconductor Technology
- Physical Vapor Phase Deposition
- Radio Frequency Amplification
- Electrospinning Preparation of Nanofiber
- Glass / Fabric Coating
- DC Reactive Magnetron Sputtering
- Cyclotron Accelerator

Table 1. Pin Names, Colors, Functions and Specifications.

No.	Name	Description	Type	Color		Min.	Typ.	Max.
1	SDN	Shutdown logic low	Digital input		Blue	0V		0.8V
		Shutdown logic high				1.2V		5V
2	5VR	Reference voltage	Analog output		Yellow		5V	
3	CTRL	Regulation	Analog input		White	0V		5V
4	VPS	Input voltage	Power supply input		Red	23V	24V	25V
5	GND	Ground	Ground for power supply and analog & digital signals		Black		0V	
6	VOUT	Output high voltage	Power output		Brown	0V		-5kV

DESCRIPTION

Figure 1 shows the actual pictures of AHV24VN5KV1MAW. Figure 2 shows its connecting wires. More detail information is given in Table 1. The high voltage output can be set to a constant value between 0V to -5kV by connecting the CTRL port to the central tap of a POT (Potentiometer) or modulated by an AC signal ranging from 0V to 5V, as see Figure 3 and Figure 4 respectively. The output voltage equals to 1000 times the input control voltage: $V_{VOUT}=1000 \times V_{CTRL}$.

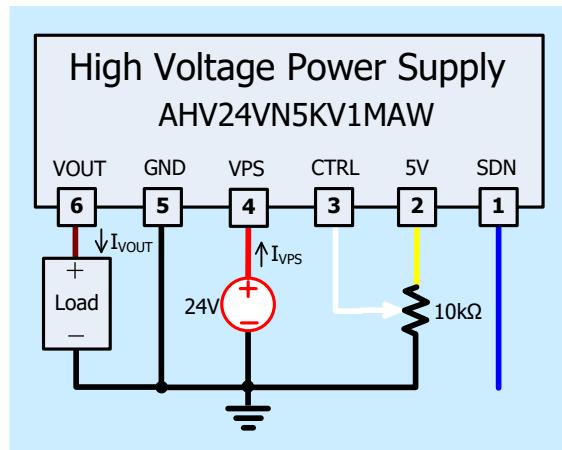


Figure 3. Setting Output to be a Constant Voltage

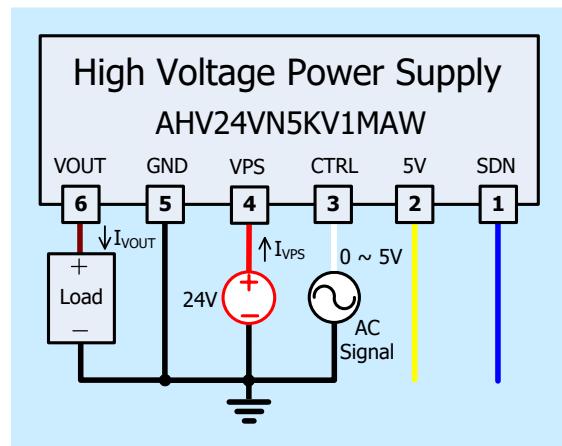


Figure 4. Modulating Output by an AC Signal Source

Please note that the modulation signal must have a low frequency $\leq 10\text{Hz}$ and the value range must be $0\text{V} \leq V_{CTRL} \leq 5\text{V}$. The equivalent input circuit for the CTRL is shown in Figure 5.

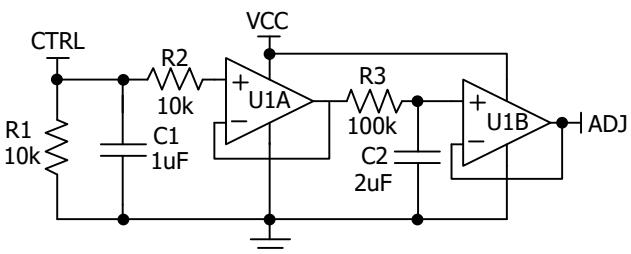


Figure 5. The Equivalent Circuit for CTRL Port

To shutdown AHV24VN5KV1MAW, pull down SDN pin to $<0.8\text{V}$; to turn it on, leave SDN pin unconnected or pull it $>1.2\text{V}$. The maximum voltage allowed on the SDN pin is 5V. The equivalent circuit for SDN port is shown in Figure 6.

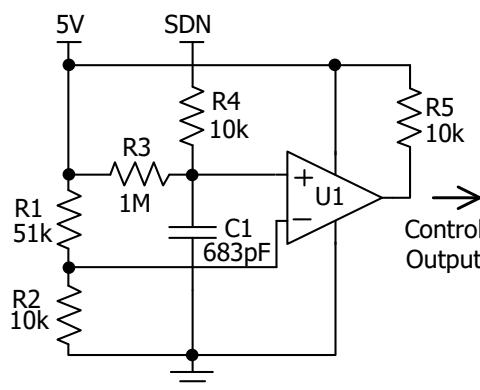



Figure 6. The Equivalent Circuit for SDN Port

USING AHV24VN5KV1MAW

This high voltage power supply must be mounted tightly onto a metal plate, ideally, thus expanding its heating sinking capacity of the metal enclosure. Sufficient ventilation must be provided to keep the power supply surface temperature under 55°C.

SAFETY PRECAUTIONS

Although AHV24VN5KV1MAW high voltage power supply comes with an over current protection circuit, a short circuit at the output should always be avoided. Make sure the high voltage wire for connecting VOUT node has sufficient insulation capability with its surrounding objects.

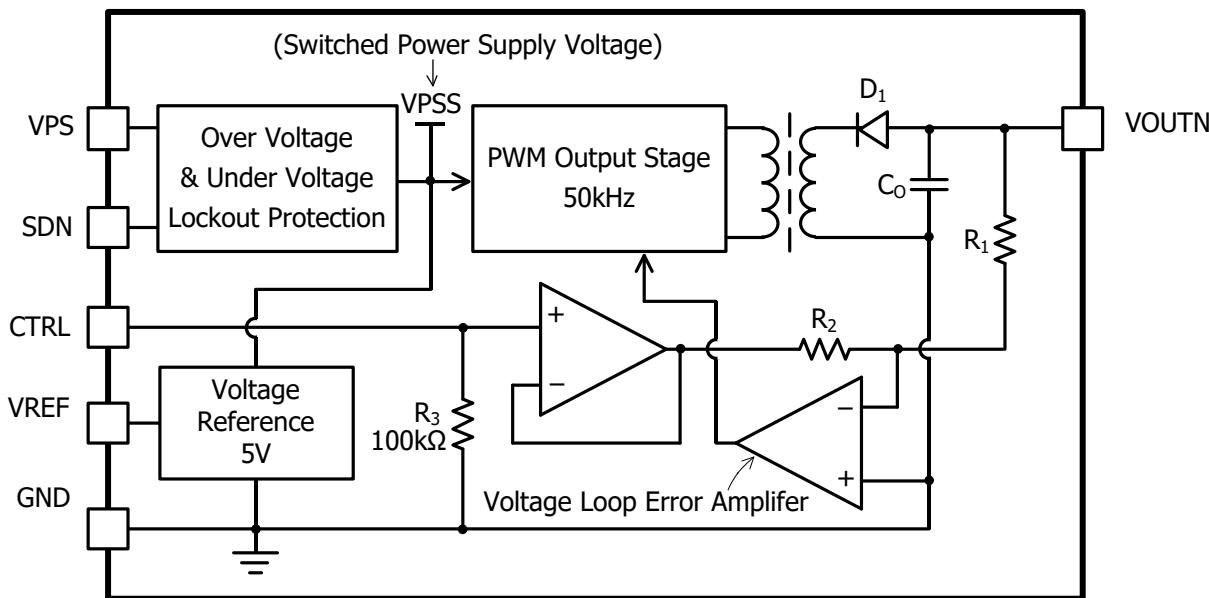

$$VOUTN = -N \times V_{CTRL}, \text{ where } N \text{ is the amplification factor: } N = R_1/R_2.$$

High Voltage Power Supply Function Block Diagram

SPECIFICATIONS

Table 2. Characteristics. $T_A = 25^\circ\text{C}$, unless otherwise noted.

Parameter	Symbol	Test Conditions	Min.	Typ.	Max.	Unit/Note
Input Power Supply Voltage	V_{VPS}		23	24	25	V
Input Power Supply Quiescent Current	I_{VPS_QC}	$I_{VOUT} = 0\text{mA}$	65	75	85	mA
Input Power Supply Current at Full Load	I_{VPS_FL}	$I_{VOUT} = 1.0\text{mA}$	250	300	350	mA
Input Power Current at Shutdown	I_{VPS_SHDN}	$T_A = -10^\circ\text{C} \sim 55^\circ\text{C}$		16		mA
Modulation Voltage Range on CTRL	V_{CTRL}		0		5	V
Modulation Voltage Range Frequency on CTRL	f_{CTRL}		0		12	Hz
Shutdown Port Current	I_{SDNL}	$V_{SDNL} < 0.8\text{V}$	-5		-4.2	μA
	I_{SDNH}	$1.2\text{V} < V_{SDNL} < 5\text{V}$	0		3.8	μA
Shutdown Voltage Logic Low	V_{SDNL}		0		0.8	V
Shutdown Voltage Logic High	V_{SDNH}		1.2		5	V
Output Voltage	V_{VOUT}	$I_{VOUT} = 0 \sim 1.0\text{mA}$	0		-5000	V
Output Current Range	$I_{VOUTMAX}$	$V_{VPS} = 23\text{V} \sim 25\text{V}$	0		1.0	mA
Reference Voltage Output Range	V_{5VR}	$T_A = -10^\circ\text{C} \sim 55^\circ\text{C}$ $I_{5VR} \leq 1\text{mA}$	4.95	5	5.05	V
Reference Output Current Range	I_{5VR}	$T_A = -10^\circ\text{C} \sim 55^\circ\text{C}$ $V_{5VR} = 0 \sim 5\text{V}$	0		1	mA

Parameter	Symbol	Test Conditions	Min.	Typ.	Max.	Unit/Note
Output Load Resistance Range					∞	MΩ
Output Voltage Ripple	V_{VOUT_RP}	Bandwidth = 1MHz $R_{LOAD} = 5M\Omega$	≤ 2.5			V_{P-P}
Output Voltage Temperature Coefficient	TCV_{VOUT}	$V_{VPS} = 24V$ $V_{CTRL} = V_{5VR} = 5V$ $V_{VOUT} = -5kV$ $I_{VOUT} = 1mA$ $T_A = -10^{\circ}C \sim 55^{\circ}C$		≤ 0.01		%/ $^{\circ}C$
Output Voltage Range v.s. Temperature	$V_{VOUT}(T)$	$V_{VPS} = 24V$ $V_{CTRL} = V_{5VR} = 5V$ $V_{VOUT} = -5kV$ $I_{VOUT} = 1mA$ $T_A = -10^{\circ}C \sim 55^{\circ}C$	$0.99V_{VOUT}$	V_{VOUT}	$1.01V_{VOUT}$	V
Output Voltage Drift	Short Term Drift			≤ 0.5		%/min
	Long Term Drift			≤ 1		%/h
Output Voltage Rise Time	t_r	$V_{VOUT}(t_1) = -500V$ $V_{VOUT}(t_2) = -4500V$ $R_{Load} = 5M\Omega$		50		ms
Output Voltage Fall Time	t_f	$V_{VOUT}(t_2) = -4500V$ $V_{VOUT}(t_3) = -500V$ $R_{Load} = 5M\Omega$		100		ms
Mean Time Between Failure	MTBF			1M		h
Instantaneous Short Circuit Current at the Output	I_{VOUT_SC}			≤ 100		mA
Load Regulation	$\frac{ \Delta V_{VOUT} }{V_{VOUT}}$	$V_{VOUT} = -5kV$ $I_{VOUT} = 1mA$		≤ 0.05		%/mA
Full Load Efficiency	η	$V_{VPS} = 24V$ $V_{VOUT} = -5kV$ $I_{VOUT} = 1mA$		≥ 70		%
Operating Temperature Range	T_{opr}		-10		55	°C
Storage Temperature Range	T_{stg}		-20		85	°C
External Dimensions			82×55×28			mm
			3.23×2.17×1.10			inch
Weight				210		g
				0.46		lbs
				7.4		Oz

TESTING DATA

Test conditions: $V_{VPS} = 24V$, $T_A = 25^\circ C$, $R_{LOAD} = 5M\Omega$

DC Testing

The measured output voltage, V_{VOUT} , corresponding to the control port input voltage, V_{CTRL} , is shown in Figure 7.

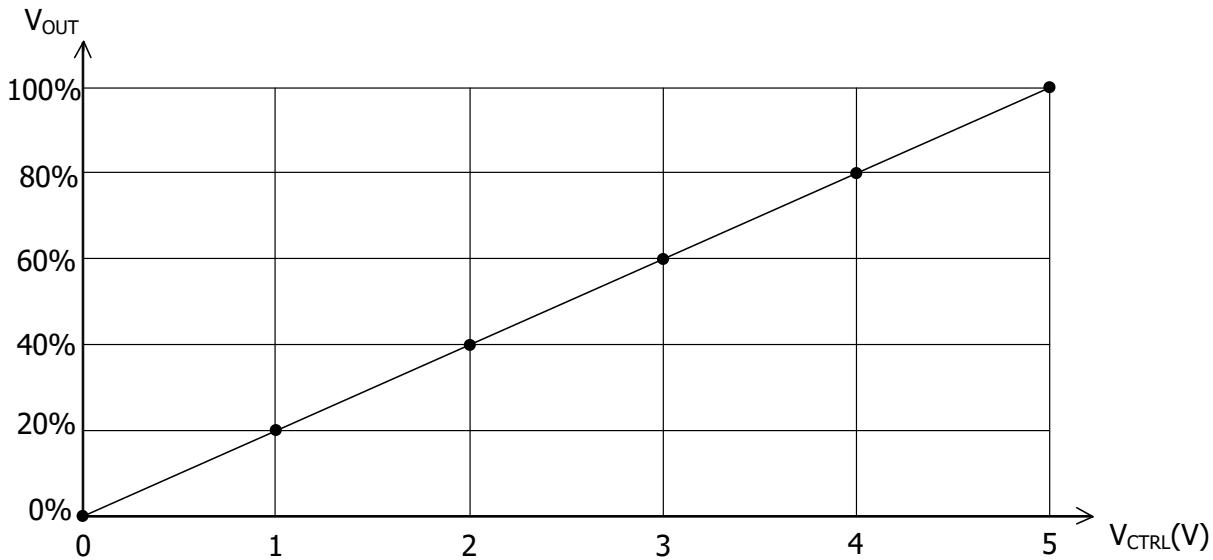


Figure 7. V_{CTRL} vs. V_{VOUT}

AC Testing

To test the analog modulation function, a triangle and sine-wave voltage signals are applied to the CTRL port as the input source signal respectively. Figure 8 and 9 show both the input signal and the output signal waveforms when using the triangle and sine-wave signals at the CTRL port respectively.

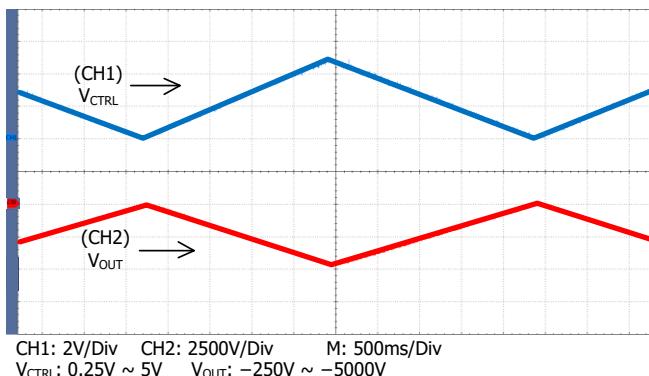


Figure 8. Triangle Wave Modulation





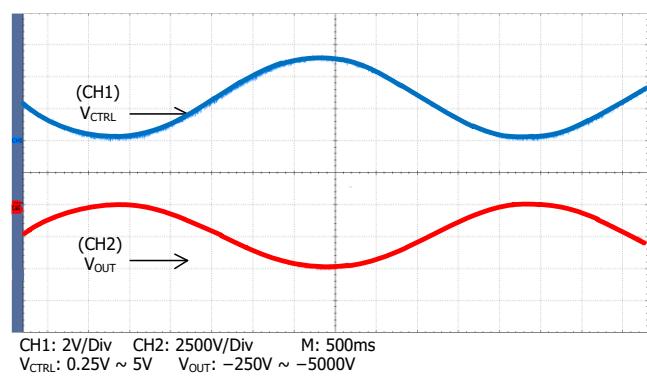


Figure 9. Sine Wave Modulation

To test the rise and fall times at the output, a step function signal is applied to the CTRL port. The testing results are shown in Figure 10, Figure 11, and Figure 12. As shown in Figure 11 and Figure 12, a square wave of $0.25V \sim 5V$, $f = 0.10Hz$, is applied to CTRL port, the output waveform fall time is measured to be about 100ms and the rise time is about 50ms. These two values are not the same, that is because on the rising trail, the power supply injects a current to the load; while on the falling trail, the best the power supply can do is to stop its output current and let the load resistor drain the output filtering capacitor to a lower voltage, and the draining current is much smaller than the injection current.

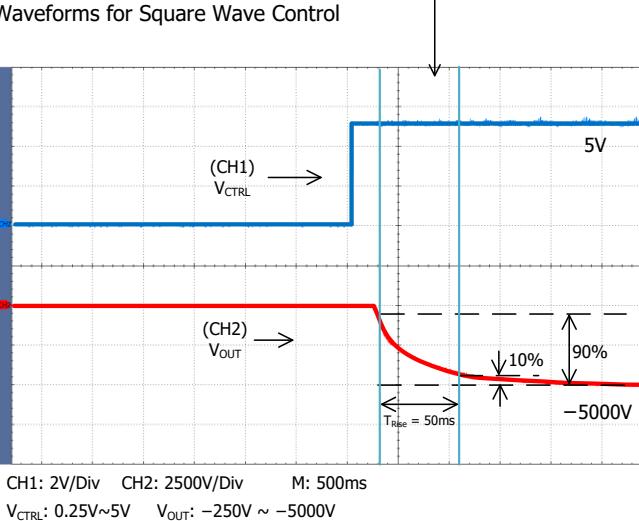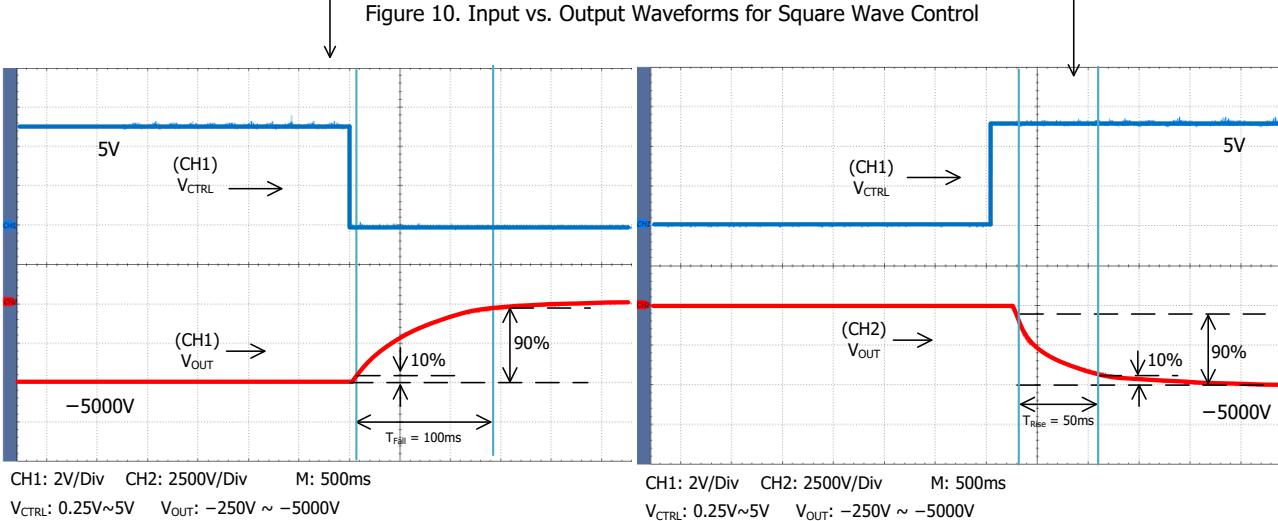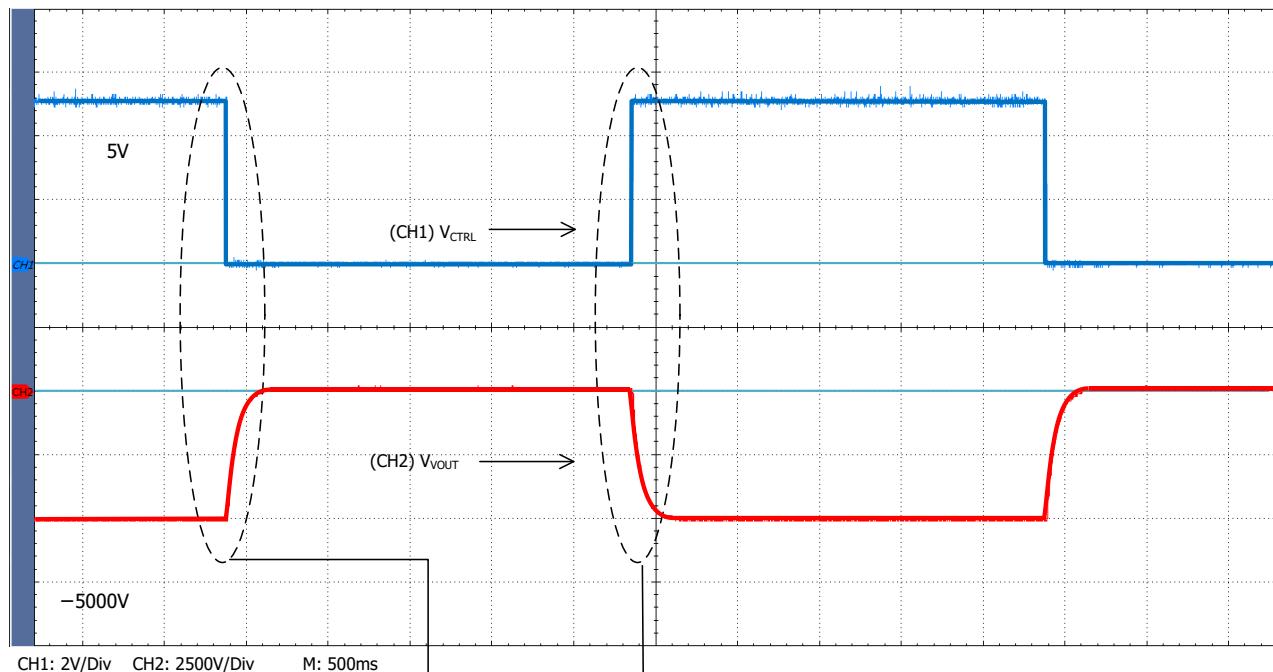

NAMING PRINCIPLE

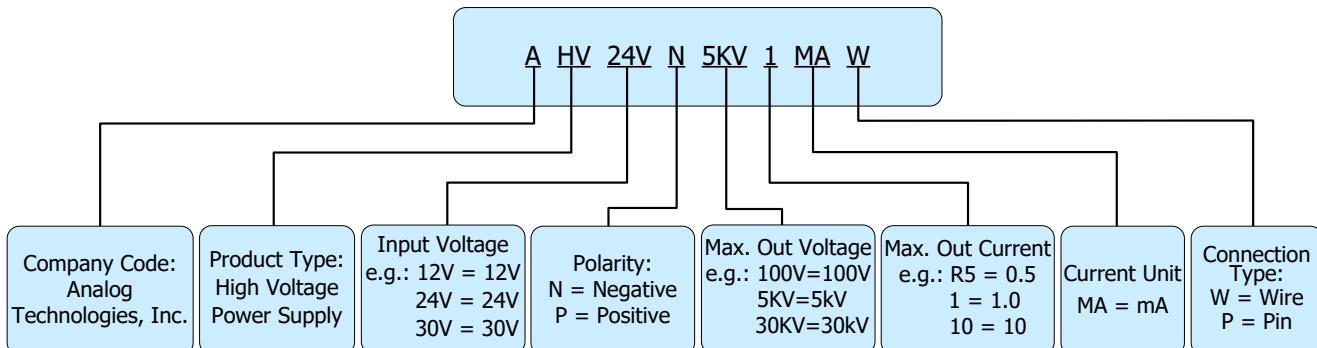

Naming Principle of AHV24VN5KV1MAW

DIMENSIONS

Connecting Lead Wire Sizes and Lengths

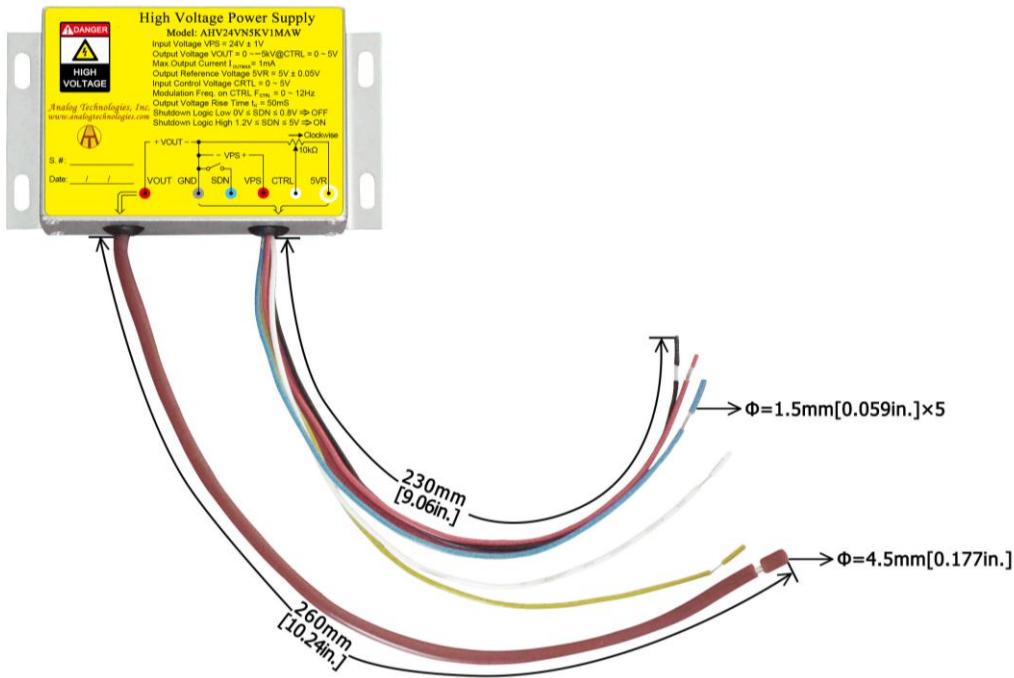


Figure 13. Connecting Lead Wires of AHV24VN5KV1MAW

Lead Wires	Diameter		Length	
	mm	inch	mm	inch
Thick brown lead wire	4.5	0.177	260 ± 1	10.24 ± 0.039
Yellow, red, blue, black and white lead wires	1.5	0.059	230 ± 1	9.06 ± 0.039

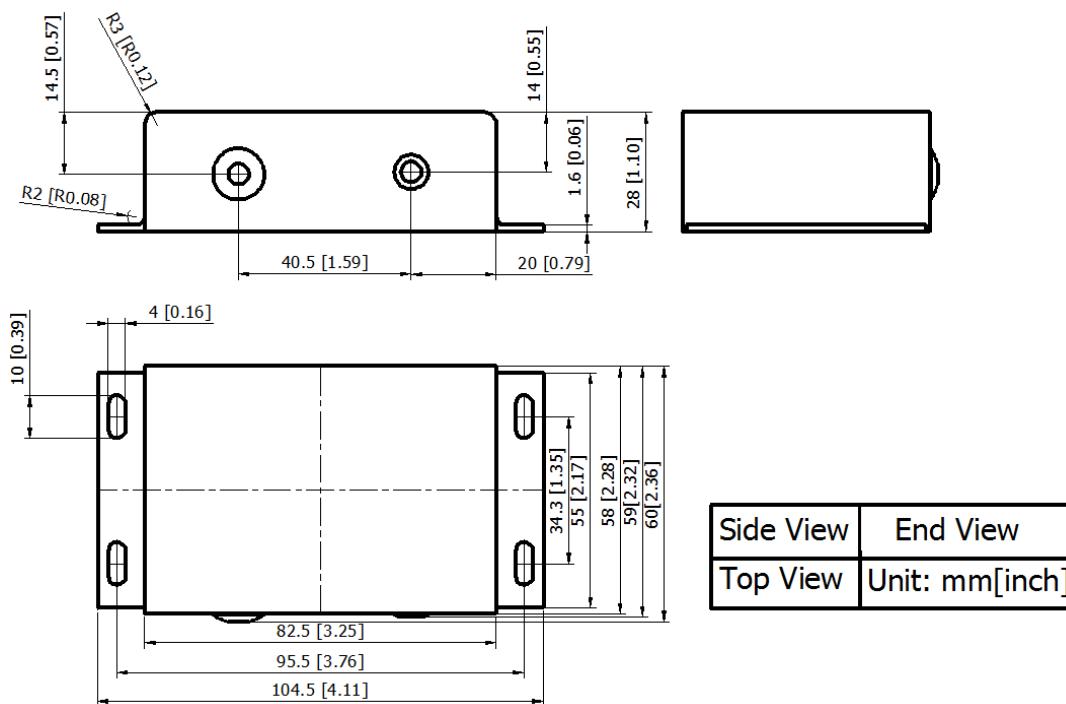
Outline Dimensions

Figure 14. Outline Dimensions

ORDERING INFORMATION

Part Number	Buy Now
AHV24VN5KV1MAW	* *

RELATED PRODUCTS

Input Voltage: 24V, Input Control Voltage: 0 to 5V, Efficiency: 70%.

Part #	Datasheet	Output Voltage (V)	Output Current (mA)	Description	Buy Now*
AHV24V500V1MAW		500	1	Positive 500V 1mA module with lead wires	* *
AHV24V500V2MAW		500	2	Positive 500V 2mA module with lead wires	* *
AHV24V500V5MAW		500	5	Positive 500V 5mA module with lead wires	* *
AHV24V500V10MAW		500	10	Positive 500V 10mA module with lead wires	* *
AHV24V500V20MAW		500	20	Positive 500V 20mA module with lead wires	* *
AHV24V500V50MAW		500	50	Positive 500V 50mA module with lead wires	* *
AHV24V600V30MAW		600	30	Positive 600V 30mA module with lead wires	* *

Part #	Datasheet	Output Voltage (V)	Output Current (mA)	Description	Buy Now*
AHV24V1KV1MAW	 PDF	1000	1	Positive 1kV 1mA module with lead wires	 *  *
AHV24V1KV2MAW	 PDF	1000	2	Positive 1kV 2mA module with lead wires	 *  *
AHV24V1KV3MAW	 PDF	1000	3	Positive 1kV 3mA module with lead wires	 *  *
AHV24V1KV5MAW	 PDF	1000	5	Positive 1kV 5mA module with lead wires	 *  *
AHV24V1KV10MAW	 PDF	1000	10	Positive 1kV 10mA module with lead wires	 *  *
AHV24V1KV20MAW	 PDF	1000	20	Positive 1kV 20mA module with lead wires	 *  *
AHV24V1500V1MAW	 PDF	1500	1	Positive 1.5kV 1mA module with lead wires	 *  *
AHV24V1500V2MAW	 PDF	1500	2	Positive 1.5kV 2mA module with lead wires	 *  *
AHV24V1500V3MAW	 PDF	1500	3	Positive 1.5kV 3mA module with lead wires	 *  *
AHV24V1500V5MAW	 PDF	1500	5	Positive 1.5kV 5mA module with lead wires	 *  *
AHV24V1500V10MAW	 PDF	1500	10	Positive 1.5kV 10mA module with lead wires	 *  *
AHV24V2KV1MAW	 PDF	2000	1	Positive 2kV 1mA module with lead wires	 *  *
AHV24V2KV2MAW	 PDF	2000	2	Positive 2kV 2mA module with lead wires	 *  *
AHV24V2KV3MAW	 PDF	2000	3	Positive 2kV 3mA module with lead wires	 *  *
AHV24V2KV5MAW	 PDF	2000	5	Positive 2kV 5mA module with lead wires	 *  *
AHV24V2KV10MAW	 PDF	2000	10	Positive 2kV 10mA module with lead wires	 *  *
AHV24V2500V1MAW	 PDF	2500	1	Positive 2.5kV 1mA module with lead wires	 *  *
AHV24V2500V3MAW	 PDF	2500	3	Positive 2.5kV 3mA module with lead wires	 *  *
AHV24V2500V5MAW	 PDF	2500	5	Positive 2.5kV 5mA module with lead wires	 *  *
AHV24V3KV1MAW	 PDF	3000	1	Positive 3kV 1mA module with lead wires	 *  *
AHV24V3KV2MAW	 PDF	3000	2	Positive 3kV 2mA module with lead wires	 *  *
AHV24V3KV3MAW	 PDF	3000	3	Positive 3kV 3mA module with lead wires	 *  *
AHV24V3KV5MAW	 PDF	3000	5	Positive 3kV 5mA module with lead wires	 *  *
AHV24V3KV10MAW	 PDF	3000	10	Positive 3kV 10mA module with lead wires	 *  *
AHV24V4KV1MAW	 PDF	4000	1	Positive 4kV 1mA module with lead wires	 *  *
AHV24V4KV2R5MAW	 PDF	4000	2.5	Positive 4kV 2.5mA module with lead wires	 *  *
AHV24V4KV5MAW	 PDF	4000	5	Positive 4kV 5mA module with lead wires	 *  *
AHV24V5KV1MAW	 PDF	5000	1	Positive 5kV 1mA module with lead wires	 *  *
AHV24V5KV2MAW	PDF	5000	2	Positive 5kV 2mA module with lead wires	* *
AHV24V5KV4MAW	PDF	5000	4	Positive 5kV 4mA module with lead wires	* *

Part #	Datasheet	Output Voltage (V)	Output Current (mA)	Description	Buy Now*
AHV24V5KV10MAW	 PDF	5000	10	Positive 5kV 10mA module with lead wires	 *  *
AHV24V6KV1MAW	 PDF	6000	1	Positive 6kV 1mA module with lead wires	 *  *
AHV24V6KV3MAW	 PDF	6000	3	Positive 6kV 3mA module with lead wires	 *  *
AHV24V7KV1MAW	 PDF	7000	1	Positive 7kV 1mA module with lead wires	 *  *
AHV24V7KV2MAW	 PDF	7000	2	Positive 7kV 2mA module with lead wires	 *  *
AHV24V8KV1MAW	 PDF	8000	1	Positive 8kV 1mA module with lead wires	 *  *
AHV24V8KV2R5MAW	 PDF	8000	2.5	Positive 8kV 2.5mA module with lead wires	 *  *
AHV24V9KV1MAW	 PDF	9000	1	Positive 9kV 1mA module with lead wires	 *  *
AHV24V10KVR6MAW	 PDF	10,000	0.6	Positive 10kV 0.6mA module with lead wires	 *  *
AHV24V10KV1MAW	 PDF	10,000	1	Positive 10kV 1mA module with lead wires	 *  *
AHV24V10KV2MAW	 PDF	10,000	2	Positive 10kV 2mA module with lead wires	 *  *
AHV24V10KV5MAW	 PDF	10,000	5	Positive 10kV 5mA module with lead wires	 *  *
AHV24V15KVR5MAW	 PDF	15,000	0.5	Positive 15kV 0.5mA module with lead wires	 *  *
AHV24V15KV1MAW	 PDF	15,000	1	Positive 15kV 5mA module with lead wires	 *  *
AHV24V20KV1MAW	 PDF	20,000	1	Positive 20kV 1mA module with lead wires	 *  *
AHV24V25KV1MAW	 PDF	25,000	1	Positive 25kV 1mA module with lead wires	 *  *
AHV24V30KVR5MAW	 PDF	30,000	0.5	Positive 30kV 0.5mA module with lead wires	 *  *
AHV24V30KV1MAW	 PDF	30,000	1	Positive 30kV 1mA module with lead wires	 *  *
AHV24V30KV2R5MAW	 PDF	30,000	2.5	Positive 30kV 2.5mA module with lead wires	 *  *
AHV24V40KV1MAW	 PDF	40,000	1	Positive 40kV 1mA module with lead wires	 *  *
AHV24V60KV1MAW	 PDF	60,000	1	Positive 60kV 1mA module with lead wires	 *  *
AHV24VN500V1MAW	 PDF	-500	1	Negative 500V 1mA module with lead wires	 *  *
AHV24VN500V2MAW	 PDF	-500	2	Negative 500V 2mA module with lead wires	 *  *
AHV24VN500V5MAW	 PDF	-500	5	Negative 500V 5mA module with lead wires	 *  *
AHV24VN500V10MAW	 PDF	-500	10	Negative 500V 10mA module with lead wires	 *  *
AHV24VN500V20MAW	 PDF	-500	20	Negative 500V 20mA module with lead wires	 *  *
AHV24VN500V50MAW	 PDF	-500	50	Negative 500V 50mA module with lead wires	 *  *
AHV24VN1KV1MAW	 PDF	-1000	1	Negative 1kV 1mA module with lead wires	 *  *
AHV24VN1KV2MAW	PDF	-1000	2	Negative 1kV 2mA module with lead wires	* *
AHV24VN1KV3MAW	PDF	-1000	3	Negative 1kV 3mA module with lead wires	* *

Part #	Datasheet	Output Voltage (V)	Output Current (mA)	Description	Buy Now*
AHV24VN1KV5MAW	 PDF	-1000	5	Negative 1kV 5mA module with lead wires	 *  *
AHV24VN1KV10MAW	 PDF	-1000	10	Negative 1kV 10mA module with lead wires	 *  *
AHV24VN1KV20MAW	 PDF	-1000	20	Negative 1kV 20mA module with lead wires	 *  *
AHV24VN1500V1MAW	 PDF	-1500	1	Negative 1.5kV 1mA module with lead wires	 *  *
AHV24VN1500V2MAW	 PDF	-1500	2	Negative 1.5kV 2mA module with lead wires	 *  *
AHV24VN1500V3MAW	 PDF	-1500	3	Negative 1.5kV 3mA module with lead wires	 *  *
AHV24VN1500V5MAW	 PDF	-1500	5	Negative 1.5kV 5mA module with lead wires	 *  *
AHV24VN1500V10MAW	 PDF	-1500	10	Negative 1.5kV 10mA module with lead wires	 *  *
AHV24VN2KV1MAW	 PDF	-2000	1	Negative 2kV 1mA module with lead wires	 *  *
AHV24VN2KV2MAW	 PDF	-2000	2	Negative 2kV 2mA module with lead wires	 *  *
AHV24VN2KV3MAW	 PDF	-2000	3	Negative 2kV 3mA module with lead wires	 *  *
AHV24VN2KV5MAW	 PDF	-2000	5	Negative 2kV 5mA module with lead wires	 *  *
AHV24VN2KV10MAW	 PDF	-2000	10	Negative 2kV 10mA module with lead wires	 *  *
AHV24VN2500V1MAW	 PDF	-2500	1	Negative 2.5kV 1mA module with lead wires	 *  *
AHV24VN2500V3MAW	 PDF	-2500	3	Negative 2.5kV 3mA module with lead wires	 *  *
AHV24VN2500V5MAW	 PDF	-2500	5	Negative 2.5kV 5mA module with lead wires	 *  *
AHV24VN3KV1MAW	 PDF	-3000	1	Negative 3kV 1mA module with lead wires	 *  *
AHV24VN3KV2MAW	 PDF	-3000	2	Negative 3kV 2mA module with lead wires	 *  *
AHV24VN3KV3MAW	 PDF	-3000	3	Negative 3kV 3mA module with lead wires	 *  *
AHV24VN3KV5MAW	 PDF	-3000	5	Negative 3kV 5mA module with lead wires	 *  *
AHV24VN3KV10MAW	 PDF	-3000	10	Negative 3kV 10mA module with lead wires	 *  *
AHV24VN4KV1MAW	 PDF	-4000	1	Negative 4kV 1mA module with lead wires	 *  *
AHV24VN4KV2R5MAW	 PDF	-4000	2.5	Negative 4kV 2.5mA module with lead wires	 *  *
AHV24VN4KV5MAW	 PDF	-4000	5	Negative 4kV 5mA module with lead wires	 *  *
AHV24VN5KV1MAW	 PDF	-5000	1	Negative 5kV 1mA module with lead wires	 *  *
AHV24VN5KV2MAW	 PDF	-5000	2	Negative 5kV 2mA module with lead wires	 *  *
AHV24VN5KV4MAW	 PDF	-5000	4	Negative 5kV 4mA module with lead wires	 *  *
AHV24VN5KV10MAW	 PDF	-5000	10	Negative 5kV 10mA module with lead wires	 *  *
AHV24VN6KV1MAW	PDF	-6000	1	Negative 6kV 1mA module with lead wires	* *
AHV24VN6KV3MAW	PDF	-6000	3	Negative 6kV 3mA module with lead wires	* *

Part #	Datasheet	Output Voltage (V)	Output Current (mA)	Description	Buy Now*
AHV24VN7KV1MAW	 PDF	-7000	1	Negative 7kV 1mA module with lead wires	 *  *
AHV24VN7KV2MAW	 PDF	-7000	2	Negative 7kV 2mA module with lead wires	 *  *
AHV24VN8KV1MAW	 PDF	-8000	1	Negative 8kV 1mA module with lead wires	 *  *
AHV24VN8KV2R5MAW	 PDF	-8000	2.5	Negative 8kV 2.5mA module with lead wires	 *  *
AHV24VN9KV1MAW	 PDF	-9000	1	Negative 9kV 1mA module with lead wires	 *  *
AHV24VN10KVR6MAW	 PDF	-10000	0.6	Negative 10kV 0.6mA module with lead wires	 *  *
AHV24VN10KV1MAW	 PDF	-10000	1	Negative 10kV 1mA module with lead wires	 *  *
AHV24VN10KV2MAW	 PDF	-10000	2	Negative 10kV 2mA module with lead wires	 *  *
AHV24VN10KV5MAW	 PDF	-10000	5	Negative 10kV 5mA module with lead wires	 *  *
AHV24VN15KVR5MAW	 PDF	-15000	0.5	Negative 15kV 0.5mA module with lead wires	 *  *
AHV24VN15KV1MAW	 PDF	-15000	1	Negative 15kV 1mA module with lead wires	 *  *
AHV24VN20KV1MAW	 PDF	-20000	1	Negative 20kV 1mA module with lead wires	 *  *
AHV24VN25KV1MAW	 PDF	-25000	1	Negative 25kV 1mA module with lead wires	 *  *
AHV24VN30KVR5MAW	 PDF	-30000	0.5	Negative 30kV 0.5mA module with lead wires	 *  *
AHV24VN30KV1MAW	 PDF	-30000	1	Negative 30kV 1mA module with lead wires	 *  *
AHV24VN30KV2R5MAW	 PDF	-30000	2.5	Negative 30kV 2.5mA module with lead wires	 *  *
AHV24VN40KV1MAW	 PDF	-40000	1	Negative 40kV 1mA module with lead wires	 *  *

*: both  and  are our online store icons. Our products can be ordered from either one of them with the same pricing and delivery time.

NOTICE

- It is important to carefully read and follow the warnings, cautions, and product-specific notes provided with electronic components. These instructions are designed to ensure the safe and proper use of the component and to prevent damage to the component or surrounding equipment. Failure to follow these instructions could result in malfunction or failure of the component, damage to surrounding equipment, or even injury or harm to individuals. Always take the necessary precautions and seek professional assistance if unsure about proper use or handling of electronic components.
- Please note that the products and specifications described in this publication are subject to change without prior notice as we continuously improve our products. Therefore, we recommend checking the product descriptions and specifications before placing an order to ensure that they are still applicable. We also reserve

the right to discontinue the production and delivery of certain products, which means that not all products named in this publication may always be available.

3. This means that while ATI may provide information about the typical requirements and applications of their products, they cannot guarantee that their products will be suitable for all customer applications. It is the responsibility of the customer to evaluate whether an ATI product with the specified properties is appropriate for their particular application.
4. ATI warrants its products to perform according to specifications for one year from the date of sale, except when damaged due to excessive abuse. If a product fails to meet specifications within one year of the sale, it can be exchanged free of charge.
5. ATI reserves the right to make changes or discontinue products or services without notice. Customers are advised to obtain the latest information before placing orders.
6. All products are sold subject to terms and conditions of sale, including those pertaining to warranty, patent infringement, and limitation of liability. Customers are responsible for their applications using ATI products, and ATI assumes no liability for applications assistance or customer product design.
7. ATI does not grant any license, either express or implied, under any patent right, copyright, mask work right, or other intellectual property right of ATI.
8. ATI's publication of information regarding third-party products or services does not constitute approval, warranty, or endorsement.
9. ATI retains ownership of all rights for special technologies, techniques, and designs for its products and projects, as well as any modifications, improvements, and inventions made by ATI.
10. Despite operating the electronic modules as specified, malfunctions or failures may occur before the end of their usual service life due to the current state of technology. Therefore, it is crucial for customer applications that require a high level of operational safety, especially in accident prevention or life-saving systems where the malfunction or failure of electronic modules could pose a risk to human life or health, to ensure that suitable measures are taken. The customer should design their application or implement protective circuitry or redundancy to prevent injury or damage to third parties in the event of an electronic module malfunction or failure.